
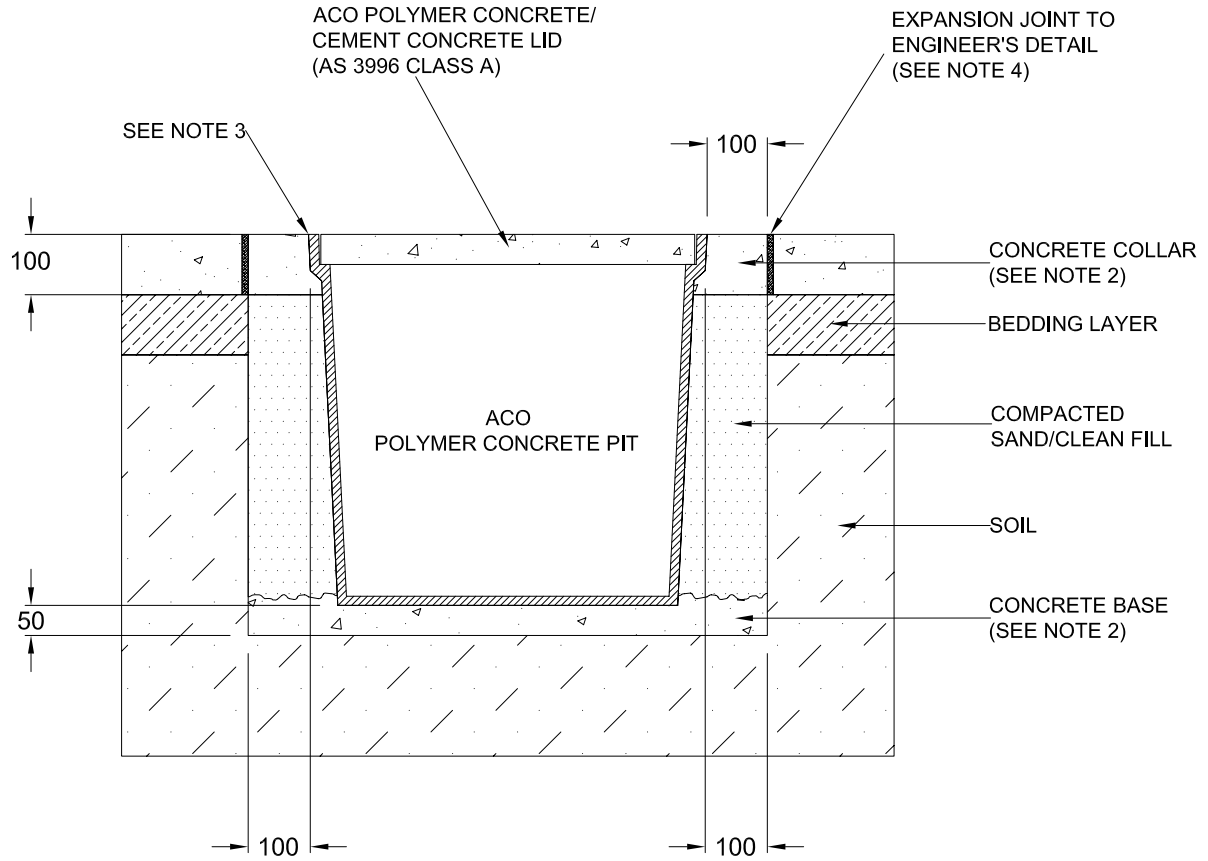


<b>ACO CABLEMATE®</b>	<b>POLYMER CONCRETE PIT INSTALLATION DRAWING</b>	
DRWG# XCPC-AC-2 www.acoaus.com.au	<b>With Polymer Concrete / Cement Concrete Lid</b>	
<b>Concrete: For 330kg Nominal Wheel Load</b>		



**NOTES:**

1. Specific site conditions may require an increase in these dimensions or reinforcement. It is the customer's responsibility to ensure the concrete collar and base is designed for the application. *Engineering advice may be required.*
2. A minimum concrete strength of 25MPa is recommended. The concrete should be vibrated to eliminate air pockets.
3. The finished level of the concrete collar must be flush with the top of the pit.
4. Expansion and crack control joints are recommended to protect the pit and the concrete collar. *Engineering advice may be required.*
5. Refer to ACO's latest installation instructions for complete details.

<b>ACO CABLEMATE®</b>	<b>POLYMER CONCRETE PIT SPECIFICATION CLAUSE</b>	ACO Polycrete Pty Ltd 134-140 Old Bathurst Road Emu Plains NSW 2750 Tel: +61 2 4747 4000 Fax: +61 2 4747 4040 E: technical@acoaus.com.au
DRWG# XCPC-AC-2 www.acoaus.com.au	<b>With Polymer Concrete / Cement Concrete Lid</b>	

The cable enclosure(s) (for a nominal wheel load of 330kg) with *clear opening(s) of .....* shall be **ACO Cablemate®** polymer concrete pit(s) *Type(s) .....* and *part no.(s) .....* with Polymer Concrete / Cement Concrete lid(s) and *part no.(s) .....*

All materials and components within the scope of this system shall be obtained from ACO Polycrete Pty Ltd and the work shall be carried out as specified in accordance with the manufacturer installation recommendations.